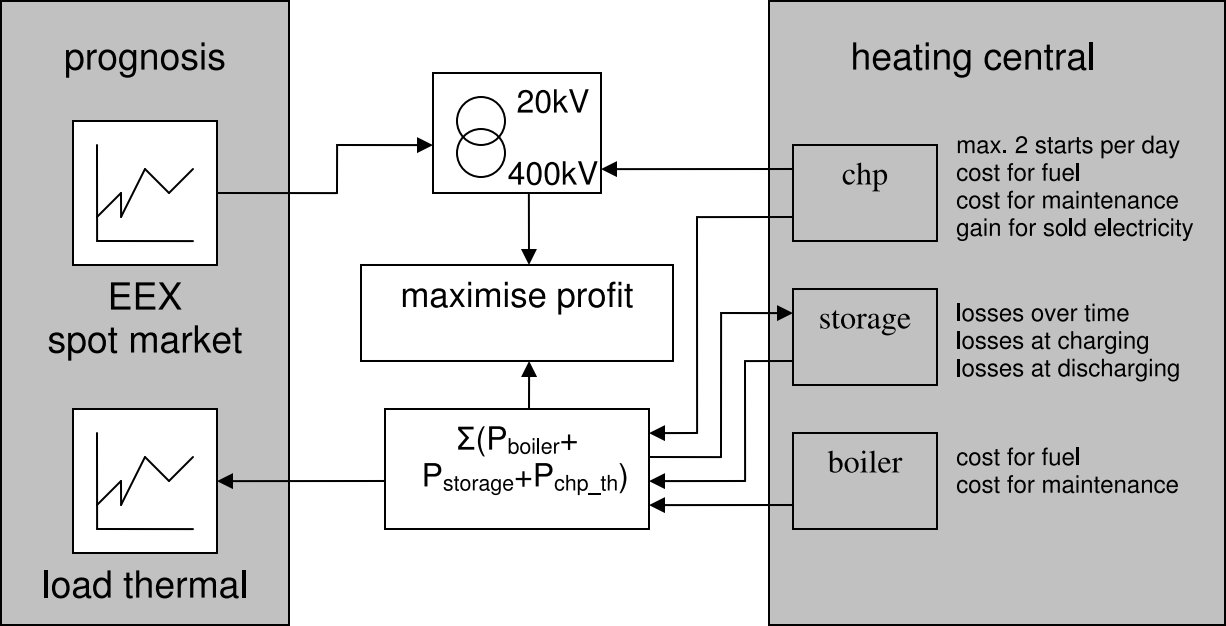
prognosis
EEX
spot market
load thermal
20kV
400kV
maximise profit
Σ(P_boiler+
P_storage+P_chp_th)
heating central
chp
max. 2 starts per day
cost for fuel
cost for maintenance
gain for sold electricity
storage
losses over time
losses at charging
losses at discharging
boiler
cost for fuel
cost for maintenance